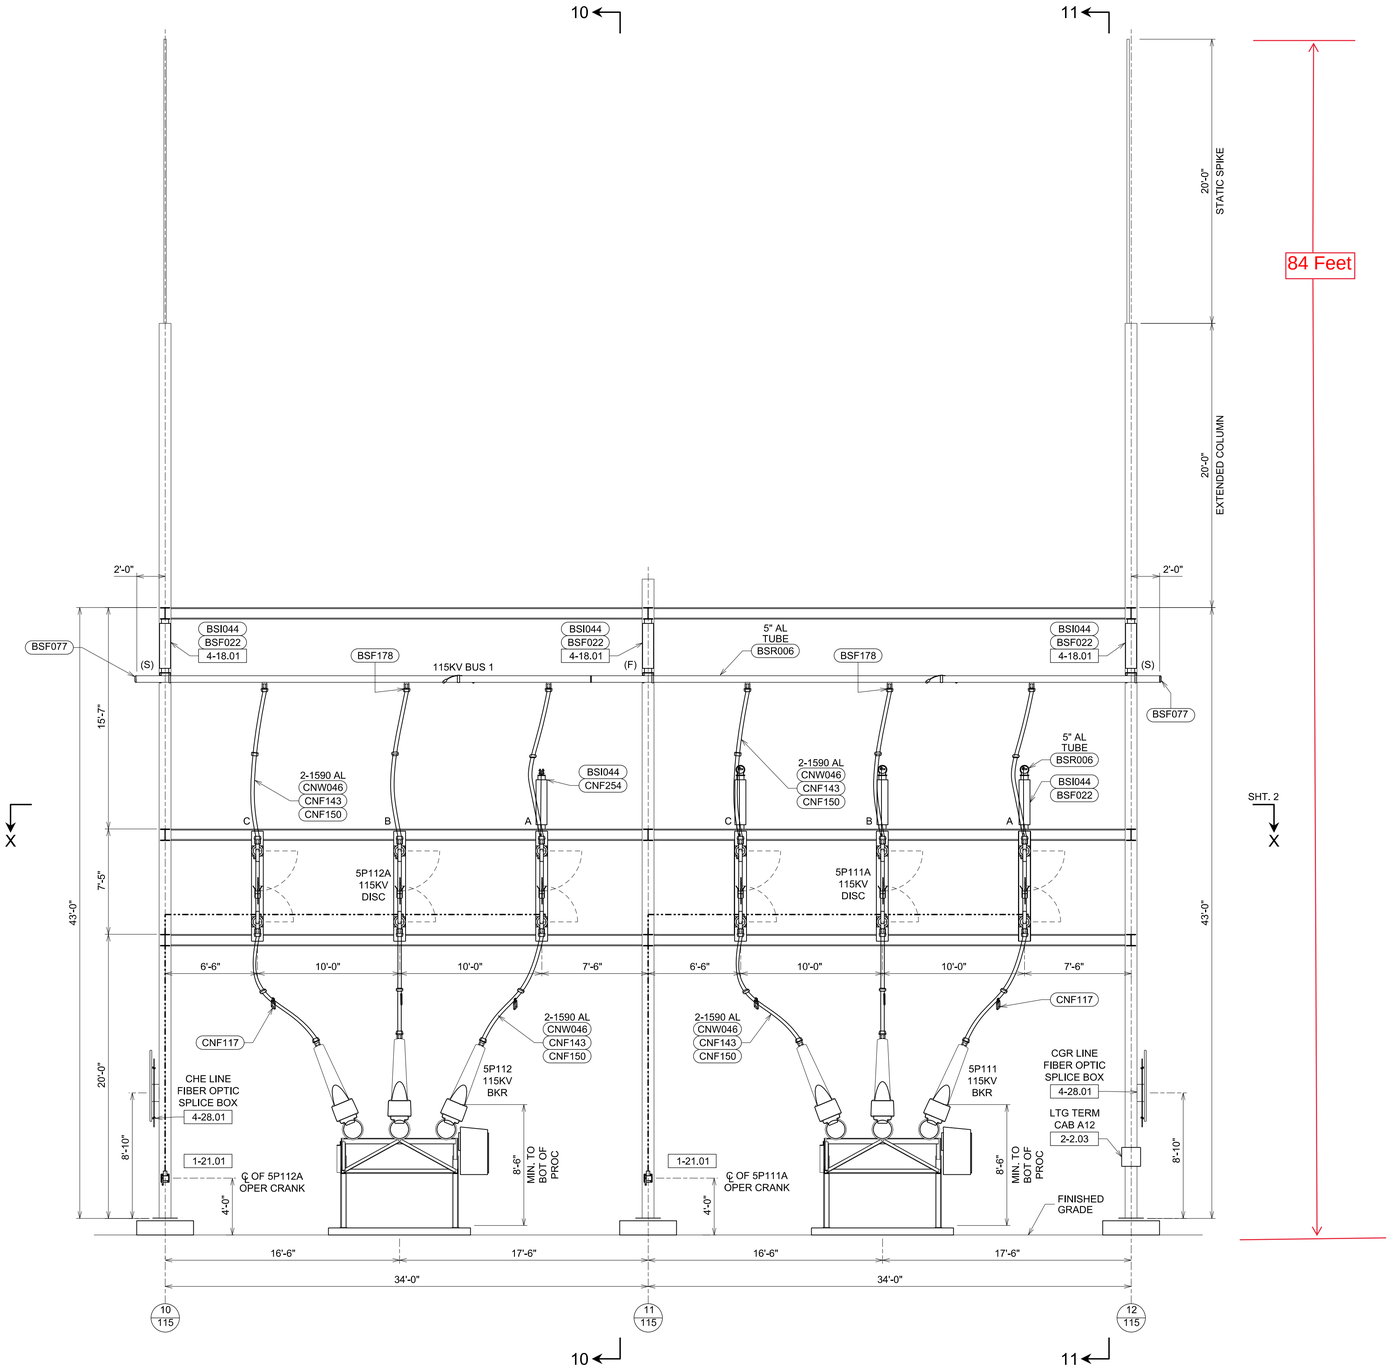


SECTION A1-A1
3/16"=1'-0

0 1' 2' 5' 10' 15' 20'
SCALE IN FEET
3/16" = 1'-0"

Sample Structure Elevation for Xcel Energy Steel Box Structure for Proposed SPU East Shakopee Substation on Reliakor Second Addition Site

Concrete Height above grade = 1 foot
Structure Height = 43 + 20 = 63 feet
Lightning Mast (Static Spike) = 20 feet
Top of Lightning Mast = 84 feet

B
0
EVERYTHING ON THIS DRAWING IS REVISION 0B

THIS PE SEAL IS ONLY APPLICABLE TO THE CURRENT CONSTRUCTION REVISION

REV	DATE	WBS 4	REVISION DESCRIPTION
0B	12/23/2019	A.0001379.002.001.002	IFC - JAM JAMAICA SUBSTATION TAM

FOR GENERAL NOTES AND LEGEND SEE SHEET 1.
FOR DRAWING REFERENCE AND REVISION INFORMATION SEE PHYSICAL INDEX SHEET.

THE SIGNED DRAWING IS THE CORRECT RECORD DOCUMENT, NOT THE AUTOCAD DISKETTE.

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA
DATE 12/23/2019 REG. NO. 53676
COLIN MCCORMICK

ISSUED BY ENGINEERING DEPT FOR: CONSTRUCTION

THIS MAP/DOCUMENT IS A TOOL TO ASSIST EMPLOYEES IN THE PERFORMANCE OF THEIR JOBS.YOUR PERSONAL SAFETY IS PROVIDED FOR BY USING SAFETY PRACTICES, PROCEDURES AND EQUIPMENT AS DESCRIBED IN THE SAFETY TRAINING PROGRAMS, MANUALS AND SPARS.
INTERNAL INFORMATION: DO NOT COPY OR DISTRIBUTE WITHOUT EXPRESS WRITTEN CONSENT FROM XCEL ENERGY

JAMAICA SUBSTATION
JAM
ELECTRICAL LAYOUT
115KV SECTIONS

Xcel Energy®
NH-281446-7
SCALE 3/16"=1'-0"
REV 0

12/19/2019 1:44:08 PM
NH-281446-7.DGN