


56'

North

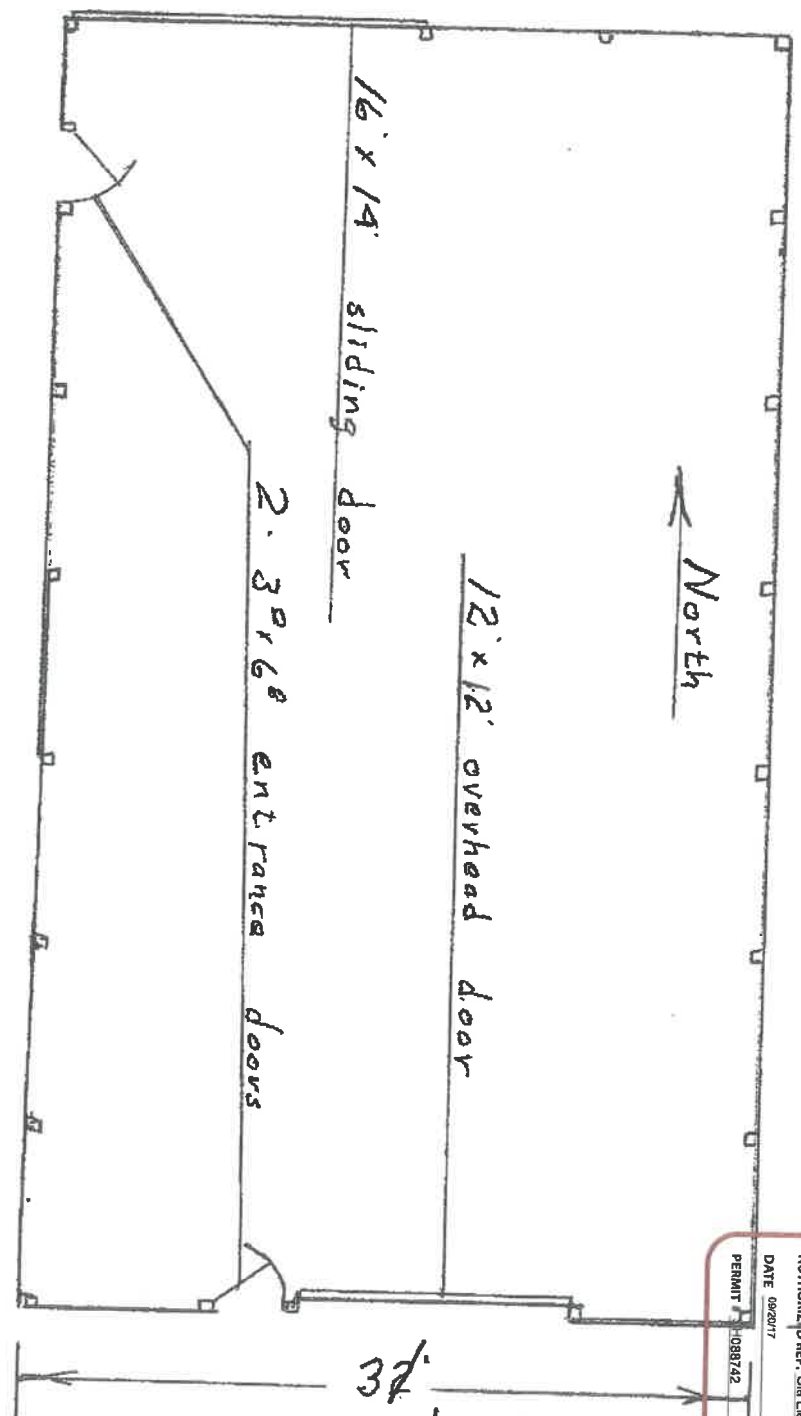

SHAKOPEE
BUILDING INSPECTIONS

REVIEWED FOR CODE COMPLIANCE

AUTHORIZED REP. Gia Eley

DATE 09/20/17

PERMIT 1088742

Brad Reiland

32' x 56' - 14' sidewalls

Scale 1/8" = 1 ft.

ROOF TRUSSES @ 4'-0" O.C. SEE MFGRS.
DRAWINGS FOR TRUSS DETAILS & LATERAL
BRACING. SEE ALSO SPECS.

2X4 CONT. LATERAL BRACING @ 10'-0" O.C.
(MAX.) ATTACHED TO EA. TRUSS
ENDWALLS W/ (2) 16d COM. NAILS

29 GAUGE COLORED STEEL
ROOF PANELS AND TRIM.

2X4 ROOF PURLINS @ 22" O.C.
NAILED W/ (2) 16d COM. NAILS.

NOTCH POST 1 1/2" FOR ROOF
TRUSS. NAIL TO POST W/
(6) 4" RINGSHANK NAILS.

METAL EAVE TRIM
AND VENTED SOFFIT.

29 GAUGE COLORED STEEL
WALL PANELS AND TRIM.
2X4 WALL GIRTS @ 20" O.C. NAILED
W/ (2) 4" RINGSHANK NAILS.
(3) PLY 2X6 TREATED POSTS @ 8'-0" O.C.

2X 1/2 X 16'-0" INSIDE & OUTSIDE LEDGER.
NAIL EA LEDGER TO COLUMN W/ (2) 4"
RINGSHANK NAILS. (STAGGER SPLICES,
PRE-DRILL AS REQUIRED TO PREVENT
SPLITTING)

29 GAUGE COLORED STEEL
WAINSCOT & TRIM

SLOPE GRADE AWAY
FROM BUILDING.

2X8 TREATED
SPLASH PLANK.


CONCRETE FLOOR
BY OTHERS.

COMPACTED BACKFILL.

TREATED 2X6 X 16"
BLOCKING (ON 2 SIDES)
NAILED TO EACH FACE W/
(4) GALV. 4" RINGSHANK NAILS.
16" x 8" on end posts

CONCRETE FOOTING.

SIDEWALL SECTION

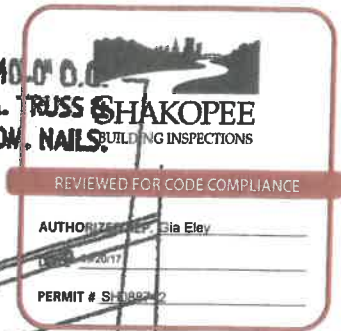

Brad Reiland

3/2 x 56' - 1/4' side walls

36
1/2"